

Test Report

FOR: **Decorative Ceiling Tiles**
Margate, FL.

Sound Absorption
RAL™-A15-259

CONDUCTED: 2015-09-15

Page 1 of 7

ON: Micro-Perforated Acoustical Aluminum Ceiling Tile with SoundTex™ - #MPA-1

TEST METHOD

Riverbank Acoustical Laboratories™ is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2005 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-09a: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-05(2012): "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measuring procedure and room qualifications is available upon request.

DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the manufacturer as Micro-Perforated Acoustical Aluminum Ceiling Tile with SoundTex™ - #MPA-1. A full internal inspection was performed on the test specimen by Riverbank personnel, verifying the manufacturer's description.

Detail of Ceiling Tiles

Material: Micro-perforated, powder coated, aluminum with SoundTex™
Dimensions: Sixteen at 603.25 mm (23.75 in.) wide by 603.25 mm (23.75 in.) long
Material Thickness: 22 gauge, 0.66 mm (0.03 in.)
Perforations:
Diameter: 1.45 mm (0.06 in.)
Pitch: 60° staggered center, 3.0 mm (0.12 in.) on center
Open Area: 21.2% in perforated region

Note: SoundTex™ was adhered to the backside of each ceiling tile.

Physical Measures

Size: 2.37 m (93.50 in.) wide by 2.74 m (107.75 in.) long
Thickness: 10.16 mm (0.40 in.)
Weight: 9.64 kg (21.25 lbs.)
Mass per Unit Area: 1.46 kg/m² (0.30 lbs/ft²)
Area: 6.50 m² (70.00 ft²)

Test Environment

Volume: 292.0 m³ (10,311.0 ft³)
Temperature: 22.3±0.0°C (72.1±0.0°F)
Humidity: 57.6±0.5%
Barometric Pressure: 99.5 kPa.



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

Test Report

Decorative Ceiling Tiles
2015-09-15

RAL™-A15-259
Page 2 of 7

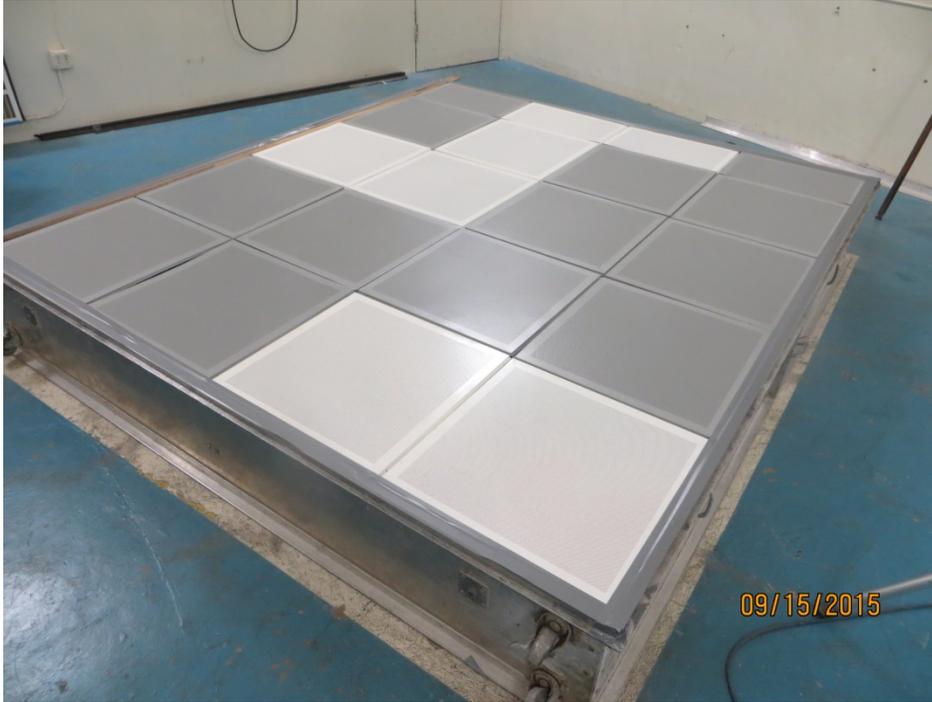


Figure 1 – Specimen mounted in the test chamber.



Figure 2 – Detail of the test specimen.



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

Test Report

Decorative Ceiling Tiles
2015-09-15

RAL™-A15-259
Page 3 of 7

MOUNTING METHOD

Type E-400 Mounting: The test specimen was mounted with an airspace behind it. The number designates the distance in millimeters from the exposed face of the test specimen to the test surface. The perimeter was sealed using tape and metal framing.

TEST RESULTS

1/3 Octave Center Frequency (Hz)	Total Absorption (SI) (m ²)	Total Absorption (IP) (Sabins)	Absorption Coefficient (Sabins / ft ²)
100	7.61	81.89	1.17
** 125	6.49	69.90	1.00
160	4.80	51.63	0.74
200	6.15	66.20	0.95
** 250	6.32	68.01	0.97
315	5.46	58.79	0.84
400	4.65	50.04	0.71
** 500	3.87	41.69	0.60
630	4.60	49.56	0.71
800	4.44	47.84	0.68
** 1000	4.42	47.57	0.68
1250	4.47	48.09	0.69
1600	4.54	48.86	0.70
** 2000	4.34	46.68	0.67
2500	4.34	46.72	0.67
3150	4.22	45.42	0.65
** 4000	4.26	45.82	0.65
5000	4.03	43.40	0.62

SAA = 0.74
NRC = 0.75



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

An  ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Test Report

Decorative Ceiling Tiles
2015-09-15


RAL™-A15-259
Page 4 of 7

TEST RESULTS (Continued)

The sound absorption average (SAA) is defined as a single number rating, the average, rounded to the nearest 0.01, of the sound absorption coefficient of a material for the twelve one-third octave bands from 200 through 2500 Hz, inclusive.

The noise reduction coefficient (NRC) is defined from previous versions of this same test method as the average of the coefficients at 250, 500, 1000, and 2000 Hz, expressed to the nearest integral multiple of 0.05.

Tested/Report by 
Chris Nottoli
Acoustician

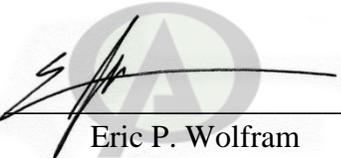Approved by 
Eric P. Wolfram
Laboratory Manager



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.


Test Report

Decorative Ceiling Tiles
2015-09-15

RAL™-A15-259
Page 5 of 7

SOUND ABSORPTION REPORT

Micro-Perforated Acoustical Aluminum Ceiling Tile with SoundTex™ - #MPA-I

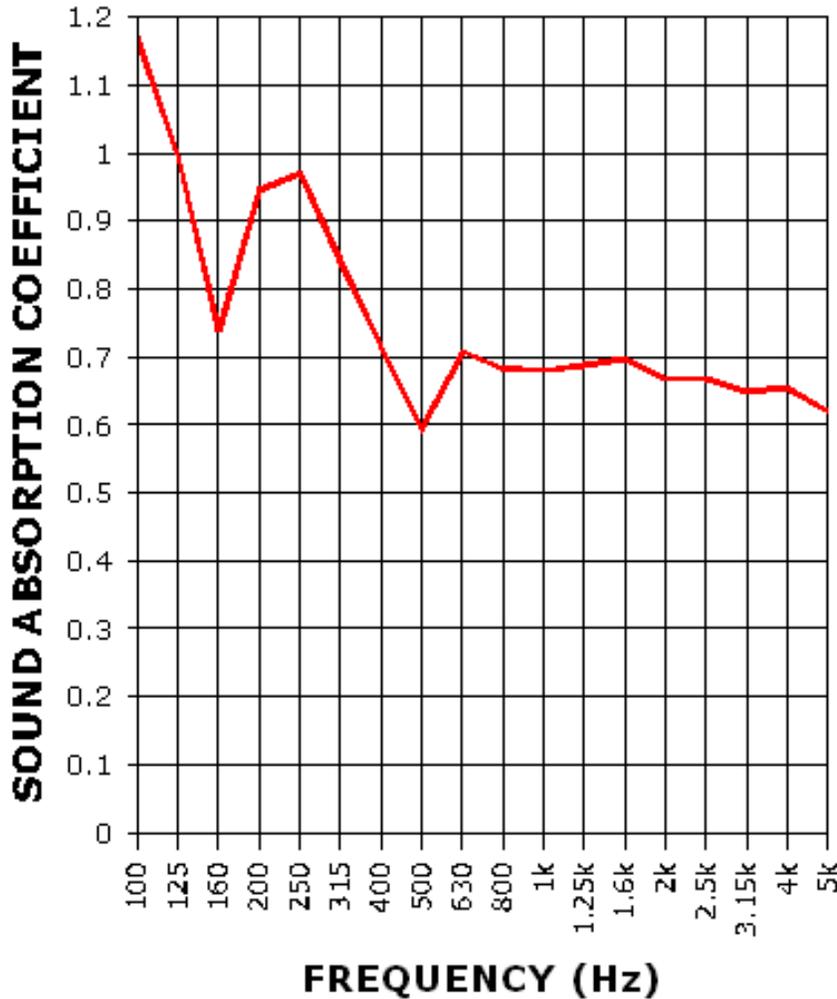

SAA = 0.74
NRC = 0.75



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

Test Report

Decorative Ceiling Tiles
 2015-09-15

RAL™-A15-259
 Page 6 of 7

APPENDIX A: Extended Frequency Range Data

Specimen: Micro-Perforated Acoustical Aluminum Ceiling Tile with SoundTex™ - #MPA-1 (See Full Report)

The following non-accredited data were obtained in accordance with ASTM C423-09a, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.

1/3 Octave Band Center Frequency (Hz)	Total Absorption (Sabins)	Absorption Coefficient (Sabins / ft ²)
31.5	30.29	0.43
40	13.72	0.20
50	32.77	0.47
63	47.23	0.67
80	22.39	0.32
<hr/>		
100	81.89	1.17
125	69.90	1.00
160	51.63	0.74
200	66.20	0.95
250	68.01	0.97
315	58.79	0.84
400	50.04	0.71
500	41.69	0.60
630	49.56	0.71
800	47.84	0.68
1000	47.57	0.68
1250	48.09	0.69
1600	48.86	0.70
2000	46.68	0.67
2500	46.72	0.67
3150	45.42	0.65
4000	45.82	0.65
5000	43.40	0.62
<hr/>		
6300	44.21	0.63
8000	44.02	0.63
10000	45.69	0.65
12500	46.28	0.66



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

An **ALION** Technical Center

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Test Report

Decorative Ceiling Tiles
2015-09-15

RAL™-A15-259
Page 7 of 7

APPENDIX B: Instruments of Traceability

Specimen: Micro-Perforated Acoustical Aluminum Ceiling Tile with SoundTex™ - #MPA-1 (See Full Report)

<u>Description</u>	<u>Model</u>	<u>Serial Number</u>	<u>Date of Certification</u>	<u>Calibration Due</u>
Bruel & Kjaer Pulse Analyzer	Type 3560-C	2647140	2015-04-08	2016-04-08
Bruel & Kjaer Mic And Preamp	Type 4943-B-001	2311427	2015-07-27	2016-07-27
Bruel & Kjaer Sound Level Calibrator	Type 4230	861609	2015-03-17	2016-03-17
Omega Digital Temp., Humid. And Pressure Recorder	OM-CP-PRHTemp2000	N11105	2014-09-30	2015-09-30

END



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.